

# CERTIFICATE

Certified Passive House Component

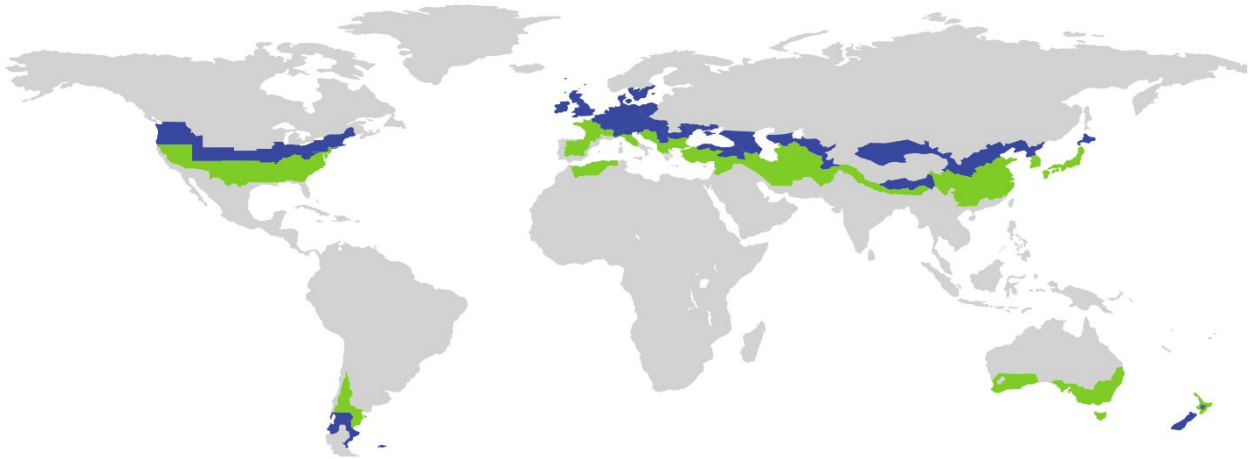
ID: 1649cc03 valid until 31 December 2022

Passive House Institute

Dr. Wolfgang Feist

64342 Darmstadt

GERMANY



Category **Column connection**  
Manufacturer **Schöck Bauteile GmbH**  
**76534 Baden-Baden**  
**GERMANY**  
Product name **Sconnex® Typ P**

**This certificate was awarded based on the following criteria for the climate zone**

## Hygiene criterion

Temperaturefactor of opaque junctions

$$f_{R_{si}=0,25m^2K/W} \geq 0.70$$

## Energy criterion

The thermal bridge coefficient is

$$X \leq X_{Max}$$



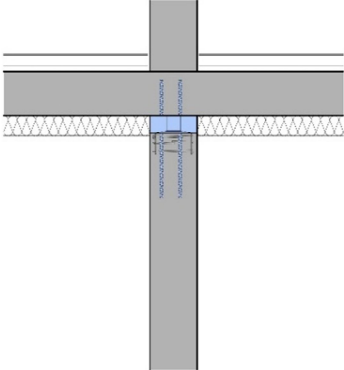
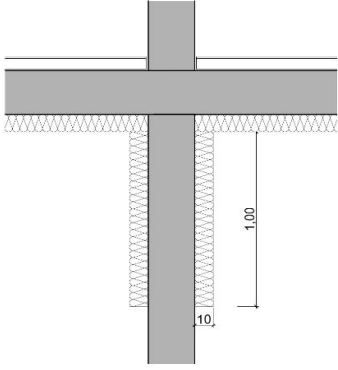
cool, temperate climate



**CERTIFIED  
COMPONENT**

Passive House Institute

## Determined values

Sconnex® Typ P	Continuous column	Reference flank-insulation
	Heat transfer coefficient ceiling <b>0.236 W/(m²K)</b>	
	Thermal bridge coefficient X <b>0.1364 W/K</b>	
	$f_{Rsi}=0.25m^2K/W$ <b>0.75</b>	
	Thermal bridge coefficient $X_{Max}$ reference flank-insulation <b>0.1477 W/K</b>	
	Thermal bridge coefficient without thermal separation <b>0.3064 W/K</b>	

### Application

Schöck Sconnex® Type P reduces the thermal bridge created in the connection detail between the reinforced concrete column and ceiling. The load-bearing thermal insulation element mainly transfers normal forces and is used at the column head. The omitted flank insulation means that reinforced concrete columns can be implemented with a continuous insulation layer.

### Note

The maximum point thermal bridge loss coefficient ( $X_{Max}$ ) for column connection situations corresponds to the point thermal bridge loss coefficient of the same construction with flank insulation (1.00 m length, 10 cm insulation thickness all round, thermal conductivity 0.035 W/(mK) without thermal separation element).

Calculations and boundary conditions according to the criteria and algorithms "Certified Passive House Components - Column- and wall- connection, Version 1.1"